


NOTES:

1. LOCATION OF UTILITY WHEN FEASIBLE
2. SUBGRADE SHALL BE COMPACTED TO 95% UNDER CURB, GUTTER, AND SIDEWALK
3. WATER METERS SHALL BE LOCATED IN 1' SETBACK BETWEEN BACK OF SIDEWALK AND R/W LINE. WATER METERS SHALL NOT BE LOCATED WITHIN SIDEWALK.

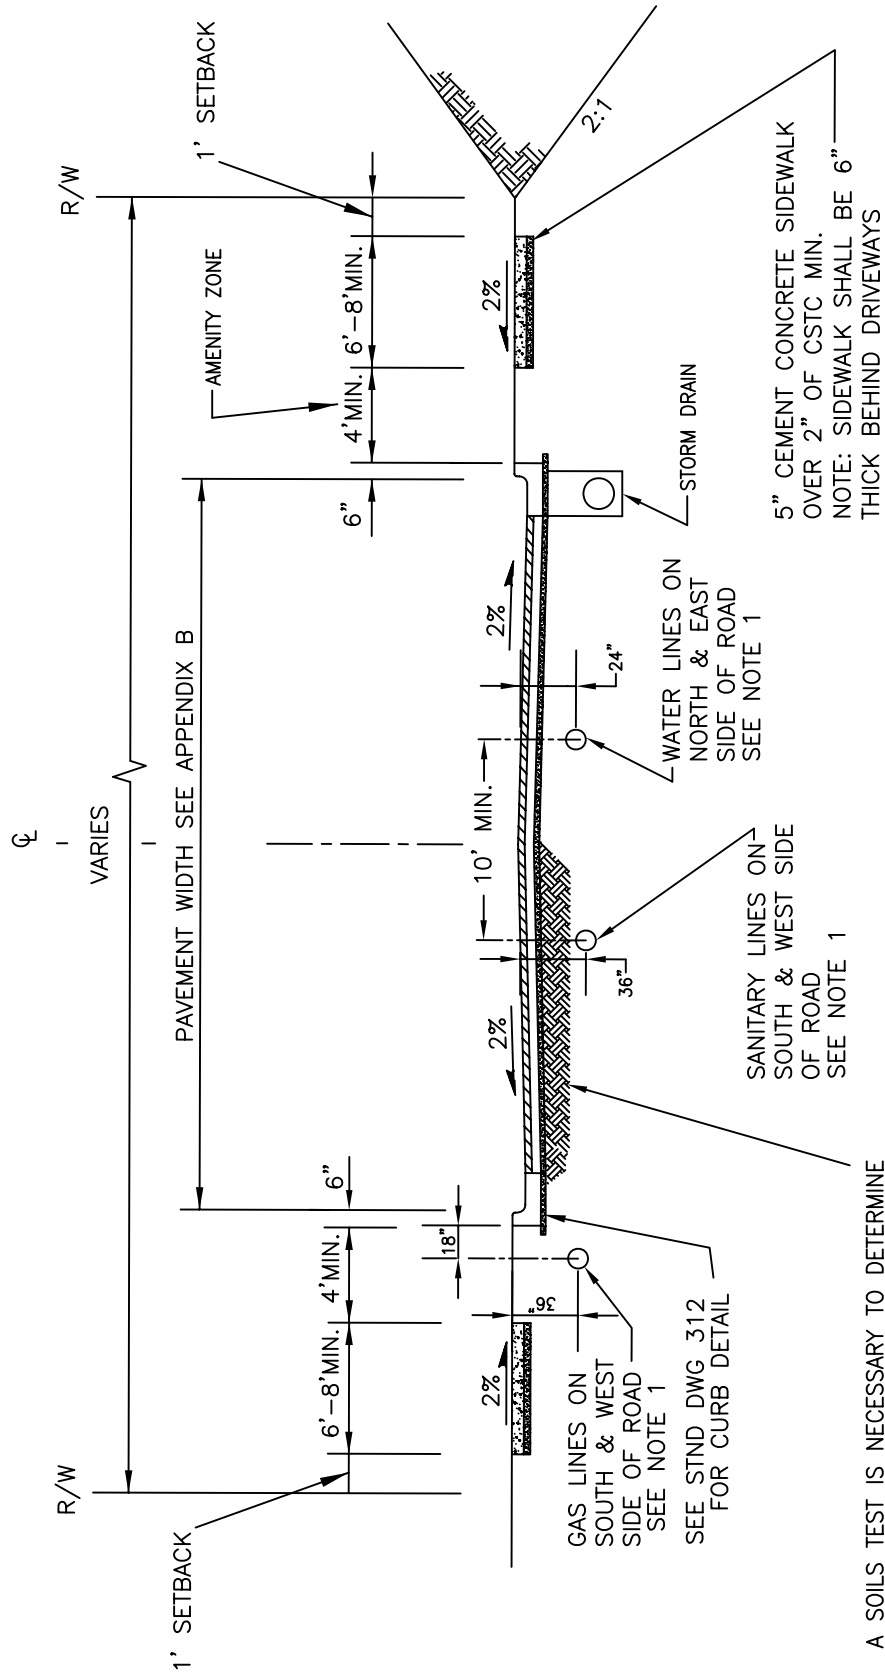

A SOILS TEST IS NECESSARY TO DETERMINE REQUIRED ASPHALT DEPTH. THE MINIMUM ALLOWABLE DEPTH IS 2" ASPHALT CONCRETE PAVEMENT CLASS "B" OVER 4" ATB OVER 2" CRUSHED SURFACING TOP COURSE. ADDITIONAL GRAVEL BORROW MAY BE REQUIRED.

	<p>Public Works Planning and Development Services</p>		<h1>Typical Arterial Street</h1>	<h1>202</h1>
				<p>NOT TO SCALE</p>
				<p>Revision Date December 2006</p>