

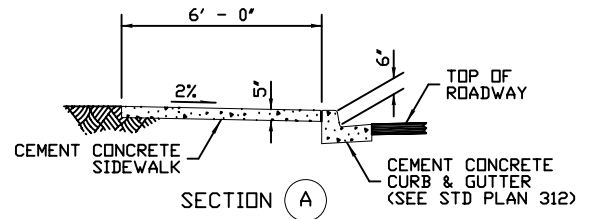
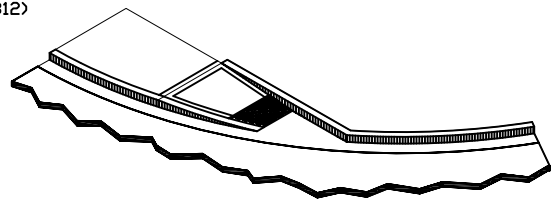


RADIUS (AT CURB FACE)	X	Y
20 FEET		2'-7 1/4"
30 FEET	7'-11 3/4"	4'-8 1/4"
40 FEET	9'-5 1/4"	6'-5"
50 FEET	10'-8 3/4"	7'-11 1/4"

INTERMEDIATE RADII CAN BE INTERPOLATED

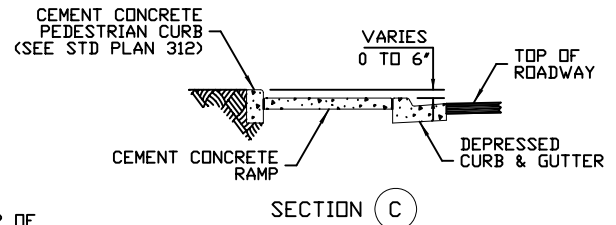

SIDEWALK RAMP TYPE A-3
PLAN

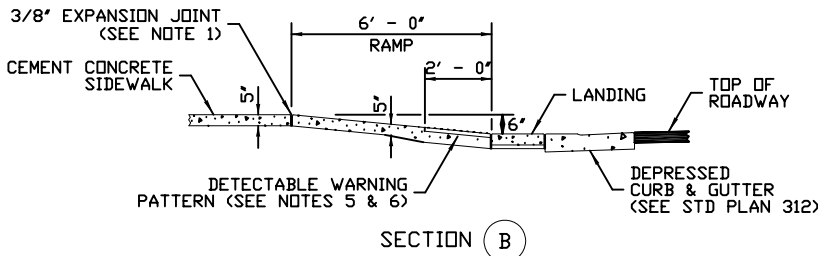


ISOMETRIC VIEW

NOTES

1. FULL DEPTH EXPANSION JOINT PER STD PLAN 309
2. CURB RAMPS SHALL BE ISOLATED BY EXPANSION JOINT MATERIAL ON ALL SIDES
3. 3/4" RADIUS DUMMY JOINT
4. CATCH BASINS & INLETS SHALL BE INSTALLED A MINIMUM OF 12" FROM THE BASE OF CURB RAMP LANDING.
5. DETECTABLE WARNING PATTERN (TRUNCATED DOMES) SHALL BE FLUSH WITH RAMP SURFACE +/- NO GREATER THAN 1/4".
6. SEE STD PLAN 318 FOR DETECTABLE WARNING PATTERN (TRUNCATED DOMES)
7. NO LAMPBLACK SHALL BE PLACED IN CURB RAMPS.



Public Works
Planning
and
Development
Services



**Curb Ramp:
Type A-3**

319

NOT TO SCALE

Revision Date
December 2006